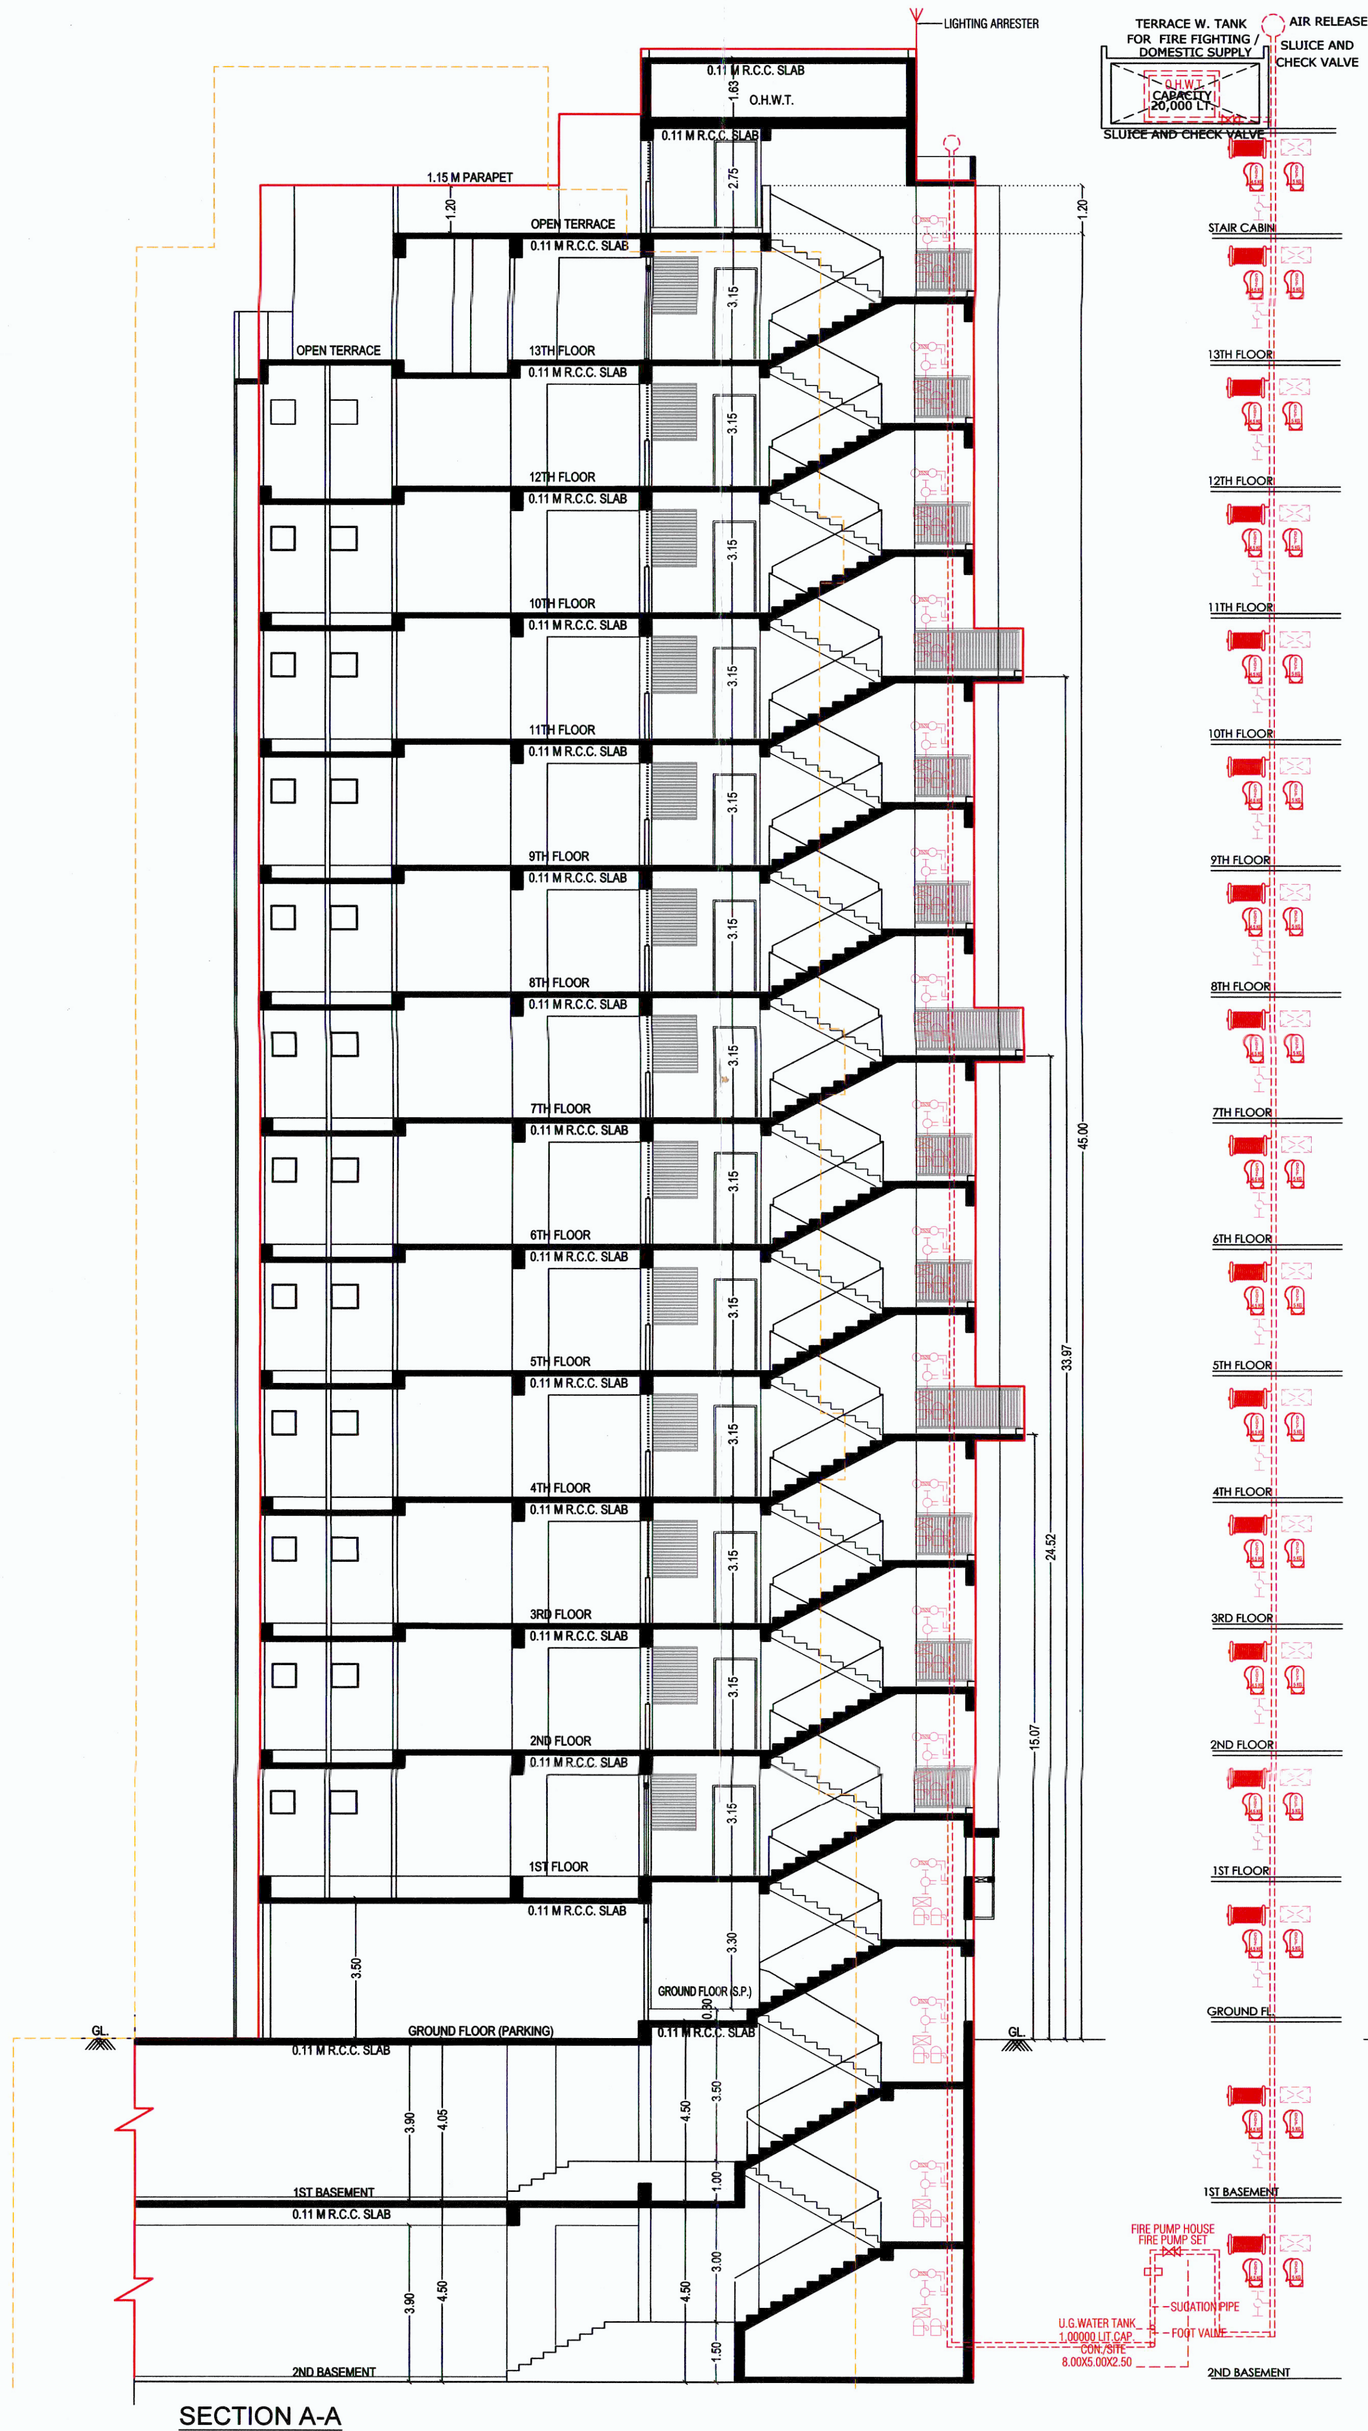

SECTION A-A

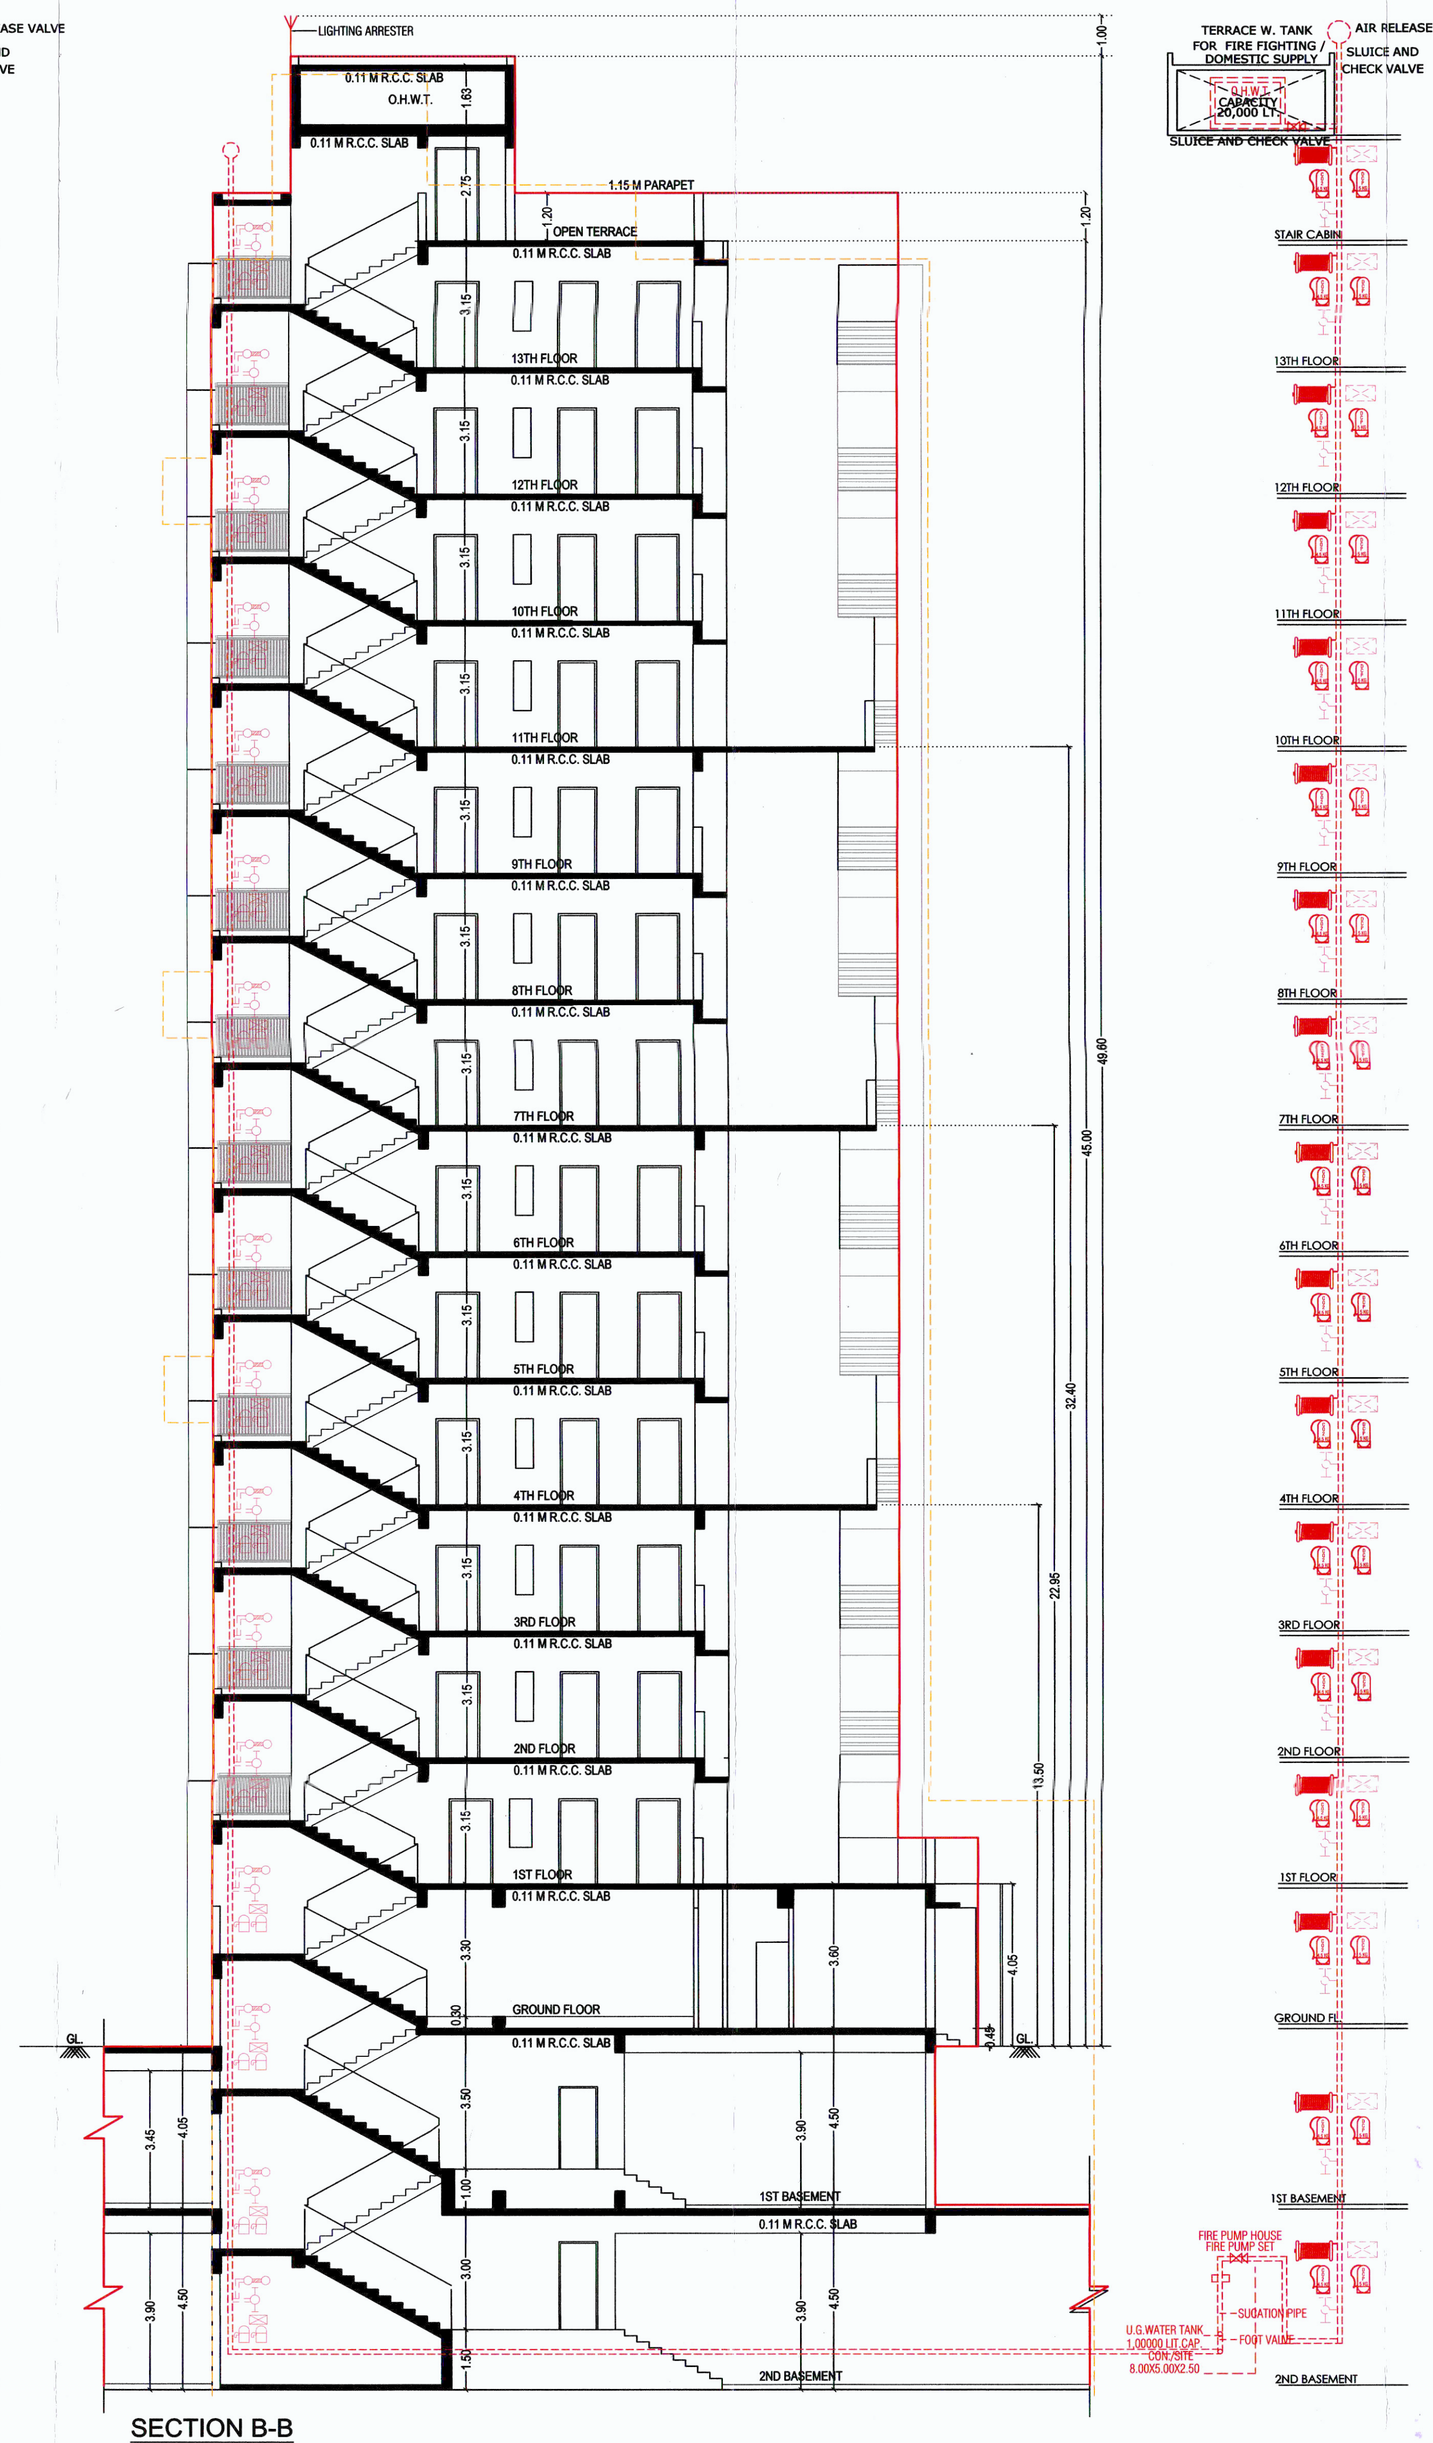

SECTION B-B

NOTES RELATED TO FIRE SAFETY.

(1) HYDRANT SYSTEM :
ON/OFF SWITCHES LOCATED NEAR THE HOSE REEL HOSE OR HYDRANT OUTLET, AT EACH FLOOR FOR THE MAIN FIRE-PUMP AT UNDERGROUND WATER TANK WITH A CAPACITY TO DISCHARGE 900 LITERS PER MINUTE AT 3 BAR PRESSURE AS MEASURED AT THE TERRACE LEVEL SHOULD BE INSTALLED.

THE RISER FOR THE BUILDINGS EXCEEDING 18 METERS HEIGHT SHOULD NOT BE OF LESS THAN 100 MM. INTERNAL DIAMETER. THE RISER SHOULD BE CONNECTED TO THE BOTTOM OF THE TERRACE TANK WITH A STOP VALVE AND A NRV TO ACT A DOWN-COMER. ONE RISER IS REQUIRED FOR EVERY 1000 SQ. METERS FLOOR AREA AND IF THE BUILDING IS DIVIDED INTO, TWO OR MORE PARTS THEN EACH PART SHOULD HAVE A SEPARATE RISER WITH ALL THE FITTINGS AT EACH FLOOR LEVEL.

EACH FLOOR SHOULD HAVE ONE HYDRANT OUTLET WITH A COUPLING FOR ATTACHING A 63 MM. DIA. HOSE. 25 MM. BORE HOSE-REEL HOSE WITH 8 MM. SHUT- OFF NOZZLE AT EACH FLOOR LANDING. THE LENGTH OF THE HOSE SHOULD BE ENOUGH TO REACH THE FARTHEST CORNER OR THE FLOOR. HOSE-BOX WITH 15 METERS LONG 63 MM. DIA. HOSE AND 12.5 MM. BORE NOZZLE AT ALTERNATE FLOORS. THE HOSE-REEL HOSE SHOULD BE COUPLED TO THE RISER.

FIRE - SERVICE INLET SHOULD BE INSTALLED AT A POINT NEAR THE ENTRY TO THE PERMISES WHERE A FIRE SERVICE VEHICLE CAN APPROACH EASILY.

A PERMANENT HYDRANT POINT COMPRISING OF 63 MM DIA SIZE 2 NOS OF HYDRANT VALVES SHOULD BE INSTALLED AT THE TERRACE LEVEL.

OVERHEAD TANK REFILLING BYPASS CONNECTION SHOULD BE DONE AT THE TERRACE LEVEL.

THE OVERHEAD TANK SHALL BE OF A CAPACITY OF NOT LESS THAN 20,000 LITERS. THE UNDERGROUND TANK SHALL BE OF NOT LESS THAN 1,00,000 LITERS.

(2) FIRE LIFT :
THE FIRE-LIFT AND ALL LIFTS SHOULD HAVE A PROVISION TO GROUND TO AUTOMATICALLY IN CASE OF ELECTRICITY FAILURE . EACH BUILDING SHOULD HAVE AT LEAST ONE LIFT AS A FIRE -LIFT AND IF THE BUILDING IS DIVIDED INTO A MORE PARTS THEN EACH PART SHOULD HAVE A FIRE-LIFT. LIFT-WELL SHOULD HAVE BLOWERS TO PRESSURIZE THE LIFT -WELL SO CONNECTED THAT IT WILL AUTOMATICALLY OPERATE WHEN ALARM CALL POINT IS OPERATE, SO THAT IF PREVENTS THE LIFT WELL GETTING SMOKE LOGGED.

(3) FIRE ALARM:
FIRE ALARM CALL POINT TO BE INSTALLED AT EACH FLOOR WITH SOUNDERS CAPABLE OF BEING HEARD ALL THROUGHOUT THE BUILDING .

(4) FIRE EXTINGUISHERS :
ONE CARBON DIOXIDE (CO_2) TYPE EXTINGUISHER OF 4.5 KG. WITH ISI MARK. AND ONE EXTINGUISHER OF 5 KG. DRY CHEMICAL POWDER (DCP) TYPE EXTINGUISHER WITH ISI MARK TO INSTALLED ON EACH FLOOR IN CASE OF COMMERCIAL BUILDING .

ONE CARBON DIOXIDE (CO_2) TYPE EXTINGUISHER OF 4.5 KG. WITH ISI MARK. OR TWO CARBON DIOXIDE (CO_2) TYPE EXTINGUISHER OF 2 KG. CAPACITY ON EACH FLOOR AND 5 KG. DRY CHEMICAL POWDER (DCP) WITH ISI MARK TYPE EXTINGUISHER ON ALTERNATE FLOOR IN CASE OF RESIDENTIAL BUILDINGS.

IF THE BUILDING IS DIVIDED INTO TWO OR MORE PARTS THEN EACH PART SHOULD HAVE THESE EXTINGUISHERS INSTALLED.

(5) STAIRCASE :
THE STAIRCASE HAS TO BE OPEN FROM AT LEAST ONE OR TWO SIDES BUT IF THE STAIRCASE IS IN THE CENTRE CORE OF THE BUILDING IT HAS TO BE PRESSURIZED TO PREVENT IT FROM GETTING SMOKE LOGGED.

THE RISER / DOWN - COMER SHOULD BE LOCATED IN THE STAIRCASE OR CLOSE TO IN TO MAKE IT EASILY APPROACHABLE IN CASE OF FIRE FROM THE FLOOR BELOW OR ABOVE.

(6) BASEMENT :
THE BASEMENT OF 200 SQ. METERS OR MORE SHOULD BE PROTECTED WITH AUTOMATIC SPRINKLER SYSTEM WITH AT LEAST ONE SPRINKLE HEAD FOR ACTUAL CAR PARKING SPACE.

ADDITIONALLY BE PROTECTED BY A HYDRANT OUTLET AND TWO 25 MM.BORE HOSE- REEL HOSES WITH 8MM . BORE NOZZLES AT EACH BASEMENT LEVEL.

(7) LIGHTENING ARRESTER :
A LIGHTENING ARRESTER SHOULD ALSO BE INSTALLED AND BE PROPERLY EARTHED TO PREVENT DAMAGE TO THE BUILDING WHEN THE LIGHTENING STRIKES.

(8) PHOTO LUMINESCENT (AUTO GLOW) SIGNAGE'S:
IF THE BUILDING FALLS IN A CONFINED AREA OR IF IT HAS AN ENCLOSED STAIRCASE OR IS NOT WELL LIT-UP ON THE INSIDE, THEN ADEQUATE PHOTO LUMINESCENT (AUTO GLOW) SIGNAGE'S SHOULD BE DISPLAYED AT EACH FLOOR / LANDING / PATHWAY / DEAD-END AND ALONG ALL EXIT ROUTES LANDING TO THE GROUND LEVEL. THE SIGNAGE SHOULD INDICATE FIRE FIGHTING, FIRE SAFETY, FIRST-AID AND OTHER SAFETY EQUIPEMENT PRESENT ON THE RESPECTIVE FLOOR / LANDING / PATHWAY / DEAD - END AND ALONG ALL EXIT ROUTES LEADING TO THE GROUND LEVEL.

(9) ELECTRIC POWER SUPPLY TO TIE ENTIRE FIRE - SAFETY SYSTEM
ELECTRICITY SUPPLY TO THE FIRE PUMP, FIRE ALARM SYSTEM, STAIRCASE PRESSURIZATION SYSTEM AND FIRE LIFT SHOULD BE MADE AVAILABLE FROM THE MAIN ELECTRICAL SUPPLY. (I.E. FROM ELECTRICAL POWER SUPPLY OF THE COMPANY) THIS IS TO ENSURE AVAILABILITY OF POWER SUPPLY TO THE FIRE PROTECTION & SAFETY SYSTEM EVEN AFTER THE MAIN ELECTRICAL SUPPLY TO THE BUILDING IS SWITCHED OFF THE TIME OF FIRE.

(10) IMPORTANT INSTRUCTIONS :-
AFTER INSPECTION OF A LOW-RISE BUILDING BY THE FIRE SERVICES AUTHORITY , IF THE FIRE OFFICER CONCERNED FEELS THE NEED FOR ADDITIONAL FIRE PREVENTION / PROTECTION / VENTILATION SYSTEM REQUIRED OR EQUIPEMENT (I.E. PASSIVE SYSTEM / SPRIKLER / DRENCHER ETC.) AS PER FIRE LOAD / FIRE RISK / PUBLIC GETHERING. POTENTIAL / OCCUPANCY / CONFINED AREA, THOSE ADDITIONAL MEASURES / EQUIPEMENT HAVE TO BE IMPLEMENTED / INSTALLED.

(11) LENGED

1	FIRE HYDRANT SYSTEM PIPE MAIN
2	SINGEL HEADED HYDRANT VALVE
3	SLUICE VALVE
4	TWOWAY SIAMES CONNECTION
5	RISE OR DROP
6	NON RETURN VALVE
7	REDUCER
8	FIRE HOUSE BOX
9	HOSE REEL HOSE
10	D.C.P. &CO.2
11	HYDRAULT VALVE

ખાસ સરતો :
વિકાસ પરવાનગી મેળવેલ બાંધકામ બાબતે જુદા જુદા તબક્કે ખોદાણ પ્રતિબંધ લેવલ (તળા દર્શક) બોલ લેવલે બોલ કરવી તરફથી જરૂર ઉભેરાણ કામો તબક્કાવાર પરિસ્થિતિ મુજબની તકેદારી રૂપે જે બાંધકામ નપાસેલ વિકાસ પરવાનગી મુજબનું છે.-તે બાબતનું પ્રમાણપત્ર મેળવ્યા બાદજ આગળના તબક્કાનું બાંધકામ કરવાનું રહેશે.

ખાસ નોંધ :
ટેકેદાર તે-આર્કિટેક્ટ એન્જીનીયર દ્વારા રજા ચિઠ્ઠી ની સાથોસાથ બધા સંબધ્ધ એજન્સી ના રિકવીજીશન કોડ (દા.ત. ફોર્મ-૧૨૮૦) તથા વિગિતવાર એસ્ટીમેન્ટ્સ ઉપર મુજબ બાબતના જુદાજુદા તબક્કાઓ પ્રમાણે તે અનુસાર અસરકારક પગલાં ભરીને ફાયનલ બાંધકામ કરવાનું રહેશે.

-: ખાસ સૂચના :-
બાંધકામ પૂર્ણ થયા બાદ બાંધકામ નો ઉપયોગ શરૂ કરતા પહેલા પિવા પાણીના અને ગંદા પાણીનાં વપરાશનું પ્રમાણપત્ર મેળવવાનું રહેશે.

ખાસ સરત :
આ બાબતો સુપ્રમાણમાં આવેલ કબજા પહેલાં બધી જુની ગટર જમીનની માલિકી સોસાયટી એસોસીએશનની ન થાય ત્યાં સુધી કોમન પ્લોટનો ઉપયોગ / માલિકી સ્વાર્થકતની રહેશે.

ખાસ સરત
ત્ય..... આ રોજ માલિક ઓર્ગેનાઈઝ આર્કિટેક્ટ તથા સ્ટ્રકચરલ એન્જીનીયરે આપેલ બાહેધરી પત્રમાં દર્શાવેલ તમામ સરતોનું ચુસ્તપણે પાલન કરવાનું રહેશે.

AFFORDABLE HOUSING PROJECT	SHEET NO:- 8 / 8
SECTION	BLOCK:- A+B

REVISED PLAN SHOWING RESI. + COMM. BUILDING ON F.P. NO: 171/3, O.P. NO: 171/3, BLOCK NO: 715/B, T.P.S. NO: 3 [GHUMA] (DRAFT SANCTION), MOJE: GHUMA, TAL.: DASKROI, DIST: AHMEDABAD.

SCALE :- 1CM = 1.0MT

ZONE AS PER RDP 2021:- RAH-1

USE OF CONSTRUCTION : RESI.+COMM. (AFFORDABLE HOUSING PROJECT)

અમદાવાદ શહેરનો વિકાસ સંચાલન અંગેના કાયદાનું ૧૯૭૬

The permission is valid only in the DP/TPS remains unaltered and further that the permission shall stand revoked as soon as there is change in DP/TPS with reference to the land under reference.

અમદાવાદ શહેરના અંદર સક્ષમ અધિકારીની મંજુરીની તારીખથી ૧ વર્ષ સુધીમાં કબ્જામાં લેવું

JIGNESH ALMOULA
AUDA/ARCH/00305
AUDA/GR-1/COW-I/00811
17, Shree Chaitanya Society,
IIM Road, Vastrapur,
AHMEDABAD-380 015.

CLERK OF WORKS

COLOUR NOTE -
- PLOT BOUNDARY
- PROPOSED WORK
- PROPOSED DRAINAGE

RCC STAIR DETAIL
WIDTH=2.04M
TREAD=0.30M
RISER=0.15M

KINAL B. SONI
ENGINEER AUDA
C-28, Sudarshan Tower, Nr. Niranl Park,
Sun-N-Step Road, Thaltej, Ahmedabad-380059.
LIC No. : AUDA/ENGG/966

ENGINEER.

DIPAK C. BHAVSAR
315 - PATEL AVENUE,
NEAR GURUDWARA, S.G. HIGHWAY
THALTEJ, AHMEDABAD-380059
Ph: 91-79-40031887
AUDA LIC No : SD-I / 00342

STRU.ENGINEER.

FOR, ANAND DEVELOPERS
AUTHORIZED SIGNATORY/PARTNER

OWNER

ANAND DEVELOPERS
REG. NO. AUDA / DEV / 01025
24, GALAXY MALL,
SATELLITE ROAD, AHMEDABAD-380015.

DEVELOPER

Owner is fully responsible For open marginal Space and road line Portion.

Final Plan boundary and allotment of final plot is Subject to Verfation by Town Planning Officer

APPROVED
As amanded by Red (Colour) Subject to the condition as mentioned in this office Letter PRN No.1091/9/2020
Dated..... 08 DEC 2020
No 413
Note Approved by Chairman

DISPATCH BY

Assistant Town Planner
Ahmedabad Urban Development Authority
Ahmedabad.

Senior Town Planner
Ahmedabad Urban Development Authority
Ahmedabad.

AUTHORITY.